




Mod. THALOS KEY


Vemer S.p.A.
I - 32052 Feltré (BL) • Via Camp. Lonc, 16
Tel. +39 0439 80638 • Fax. +39 0439 80619
e-mail: info@vemer.it • web site: www.vemer.it




2 DIMENSIONS

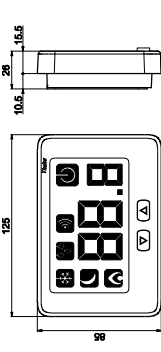

3 WIRING DIAGRAMS

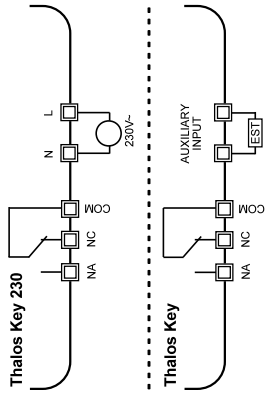



4 LEGEND



- 1 "Room temperature" Field
- 2 "Off" Field
- 3 "Heating activation" Field
- 4 "Cooling activation" Field
- 5 "Night reduction activation" Field
- 6 Key "↓" Decreases the selected field - active night reduction
- 7 Key "↑" Increases the selected field

5 INSTALLATION

- Thalos Key series thermostats are designed for wall mounting installation. Alternatively, they can be installed to cover the in-built three-modules box.
 - Install the thermostat at a height of about 1.5 m above the floor, away from direct sunlight, away from doors, windows, heat sources, locations with excess or total lack of ventilation.
- 1 Connect the wires to the terminals block on back of the base, as shown in the "wiring diagrams".
 - 2 Fix the base on the wall using the screws supplied.
 - 3 For battery-powered models only: insert the batteries into the battery compartment on the back of the thermostat, respecting the indicated polarity.
 - 4 Attach the thermostat to the base, at first mating teeth on the higher side.



1

WALL-MOUNTING ELECTRONIC THERMOSTATS

Read all instructions carefully

Series of wall mounting electronic thermostats for temperature control both in heating and cooling.

They perform actions of type 1B and are intended for operating in rooms with Pollution Degree 2 and Overvoltage Category III (EN60730-1).

- Thalos Key battery powered has an auxiliary input for a temperature probe configuration or of an external contact to reduce setpoint of 3 °C.
- Thalos Key 230 AC-powered.

Code	Model	Description
VE718300	Thalos Key Bianco	Battery Thermostat with auxiliary input
VE719100	Thalos Key Nero	Battery Thermostat with auxiliary input
VE720900	Thalos Key 230 Bianco	230V Thermostat
VE721700	Thalos Key 230 Nero	230V Thermostat

SAFETY WARNINGS

- During product installation and operation it is necessary to observe the following instructions:
- 1) The instrument must be installed by a qualified person, in strict compliance with the connection diagrams.
 - 2) Do not power or connect the instrument if any part appears to be damaged.
 - 3) After installation, inaccessibility to the connection terminals without appropriate tools must be guaranteed.
 - 4) The instrument must be installed and activated in compliance with current electric systems standards.
 - 5) Before accessing the connection terminals, verify that the leads are not live.
 - 6) In the electrical system of the building where the instrument must be installed, a switch and a protection device from the overcurrents must be present (for Thalos Key 230 models only).


TECHNICAL SPECIFICATIONS

- Power supply: Thalos Key:
 - 2 alkaline batteries 1.5V (AAA type)
 - battery life: 12 months
 - low battery indication
- Power supply Thalos Key 230:
 - 230Vac (+15% ÷ +10%) 50/60Hz
 - max absorption: 6 VA / 230Vac
- Wall mounting or to coverage the in-built three-modules box
- Terminals Thalos Key:
 - 3 terminals for 1.5 mm² cable section for bistable output relay 5A / 250 Vac
 - 2 terminals for 1.5 mm² cable section for auxiliary input (to connect a temperature probe or an external contact to reduce setpoint of 3 °C)
- Terminals Thalos Key 230:
 - 3 terminals for 1.5 mm² cable section for monostable output relay 5A / 250 Vac
 - 2 terminals for 1.5 mm² cable section for power supply
- Operating mode: summer/winter/off (with antifreeze operating mode)
- Password protected lock keypad
- Type of command:
 - on/off with settable differential (0.1 ÷ 1 °C)
 - P8 proportional with 0.8 °C band (-0.3 ÷ +0.8 °C) and period 8 minutes
 - P15 proportional with 1.5 °C band (-0.7 ÷ +0.8 °C) and period 15 minutes
- Measurement precision: ±0.3 °C
- Settable setpoint range: 2 °C ÷ 50 °C
- Operating temperature: 0 °C ÷ +50 °C
- Storage temperature: -10 °C ÷ +65 °C
- Operating humidity: 20-90% non condensing
- Degree of protection: IP40
- Insulation: reinforced among accessible parts (frontal) and all other terminals

6 OPERATION

During normal operation the thermostat displays the measured temperature value and the relay status is identified by the symbol (heating) or by the symbol (cooling).


Setpoint modification

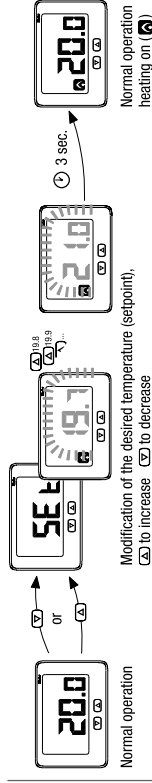

Modification of the desired temperature (setpoint),
↑ to increase ↓ to decrease


Normal operation heating on (20.0)

Depleted batteries signal




Replace the batteries as soon as possible!
Dispose of the batteries in the appropriate recycling containers.

Switch off



Note: in heating mode (winter), if the Thalos Key is off, it adjusts the antifreeze **Toff** temperature in order to prevent the system freezing. **Toff** can have values from 1 to 50 °C or be excluded; in this case any minimum temperature is guaranteed.


Error messages



Occurs for the following values of measured temperature:
t < 0 °C
t > 50 °C

Occurs in case of probe failure.
In this case the adjustment is inhibited and the relay contacts remain in COM-NC position.

Reset



Default values	Default values
Heating setpoint \uparrow	21 °C
Cooling setpoint \downarrow	25 °C
Minimum settable setpoint - L D	2 °C
Maximum settable setpoint - H I	50 °C
Operating mode	0 (heating)
Antifreeze temperature	6 °C
Type of command	On / Off
Differential	0.3 °C
Auxiliary input	DIG
Password	--- (disabled)

Unhook and re-hook the thermostat from the base (battery models) or remove and restore power (230V models).
During the flashing of the backlighting press the keys \uparrow and \downarrow until the display shows DEF.

Advanced programming

To enter menu Advanced programming keep simultaneously pressed for 5 seconds the keys \uparrow and \downarrow until Pr will appear. The items of the menu are displayed in succession. For each item is displayed an identity preview and its relative blinking value. Use the keys \uparrow and \downarrow to modify the value. The passage to the next parameter occurs after 3 seconds without pressing any key. The writing End will appear when all parameters are set and the thermostat returns to normal operation saving the effected modifications.



LD

Minimum settable setpoint - L D
It's the minimum value settable as setpoint.
Settable values: 2 ÷ 50 °C

HI

Maximum settable setpoint - H I
It's the maximum value settable as setpoint.
Settable values: L D ÷ 50 °C

E - I

Operating mode - E - I
If connected to the boiler (heating)
If connected to a cooling system

06.0

Antifreeze temperature - Toff
Minimum temperature maintained with Thalos Key off (see box «Switch off»)
Settable values: 1 ÷ 50 °C or --- (excluded function)

r EC

Type of command - r EC - (only in heating)
0 = on/off with settable differential
D = proportional with band 0.8 °C and period 8 minutes
P 15 = proportional with band 1.5 °C and period 15 minutes

d0.3

Differential - dD3 - (only for on/off regulation)
Differential (or hysteresis) for temperature regulation.
Settable values: 0.1 ÷ 1 °C

ES L

Input configuration - Est - (only battery models)
- 0 °C for one temperature probe connection
- d L I for an external contact connection to reduce setpoint (see box «Auxiliary input configuration»)

PR 5

Password for keypad lock - PR 5
Set a value between 001 and 999 to activate the keypad lock. Set 4- - - - to disable the lock.
If the keypad lock is active, pressing one key L or C appears and the password is required. If it's properly inserted the keyboard is unlocked for the next 30 seconds.

Auxiliary input configuration (only battery models)

Models battery powered have an auxiliary input that can be configured for connection instead of:
- an external temperature probe
- Closed external contact allows setpoint reduction of 3 °C than the set one. Display shows the symbol \downarrow .
For auxiliary input configuration, see «Advanced programming» in this manual.




Backlighting management

- **Battery models**
In the battery-powered supplied models the display backlighting is normally OFF and it is enabled (blue colour) entering menu: setpoint modification, advanced programming, pin enter.
- **Models 230V**
In the 230V ac power supplied models the display backlighting is normally ON.

Backlighting switching OFF

If not desired the backlighting function can be disabled (for example in bedrooms). Then the thermostat continues its normal operation and the backlighting is enabled entering menu: setpoint modification, advanced programming, pin enter.



REFERENCE STANDARDS

- Compliance with Community Directives:
2014/53/EU (LVD)
2014/30/EU (EMC)
is declared in reference to the harmonized standard:
• EN 60730-2-9